


DAFTAR PERALATAN UTAMA

CODE / KODE	TN.101	PU.101.A/B
NAME / NAMA	ROOF WATER TANK	POMPA DISTRIBUSI
TYPE / TIPE	FRP – PANEL	DISTRIBUTION PUMP (PACKAGE) – CENTRIFUGAL END SUCTION
CAPACITY / KAPASITAS	5 M3	2 X 110 LPM
TOTAL HEAD	–	1,5 BAR
POWER / DAYA	–	2 X 0,65 KW
PUTARAN/RPM	–	2900
OPERATION / OPERASI	–	2 PARALEL ALT. (VSD)

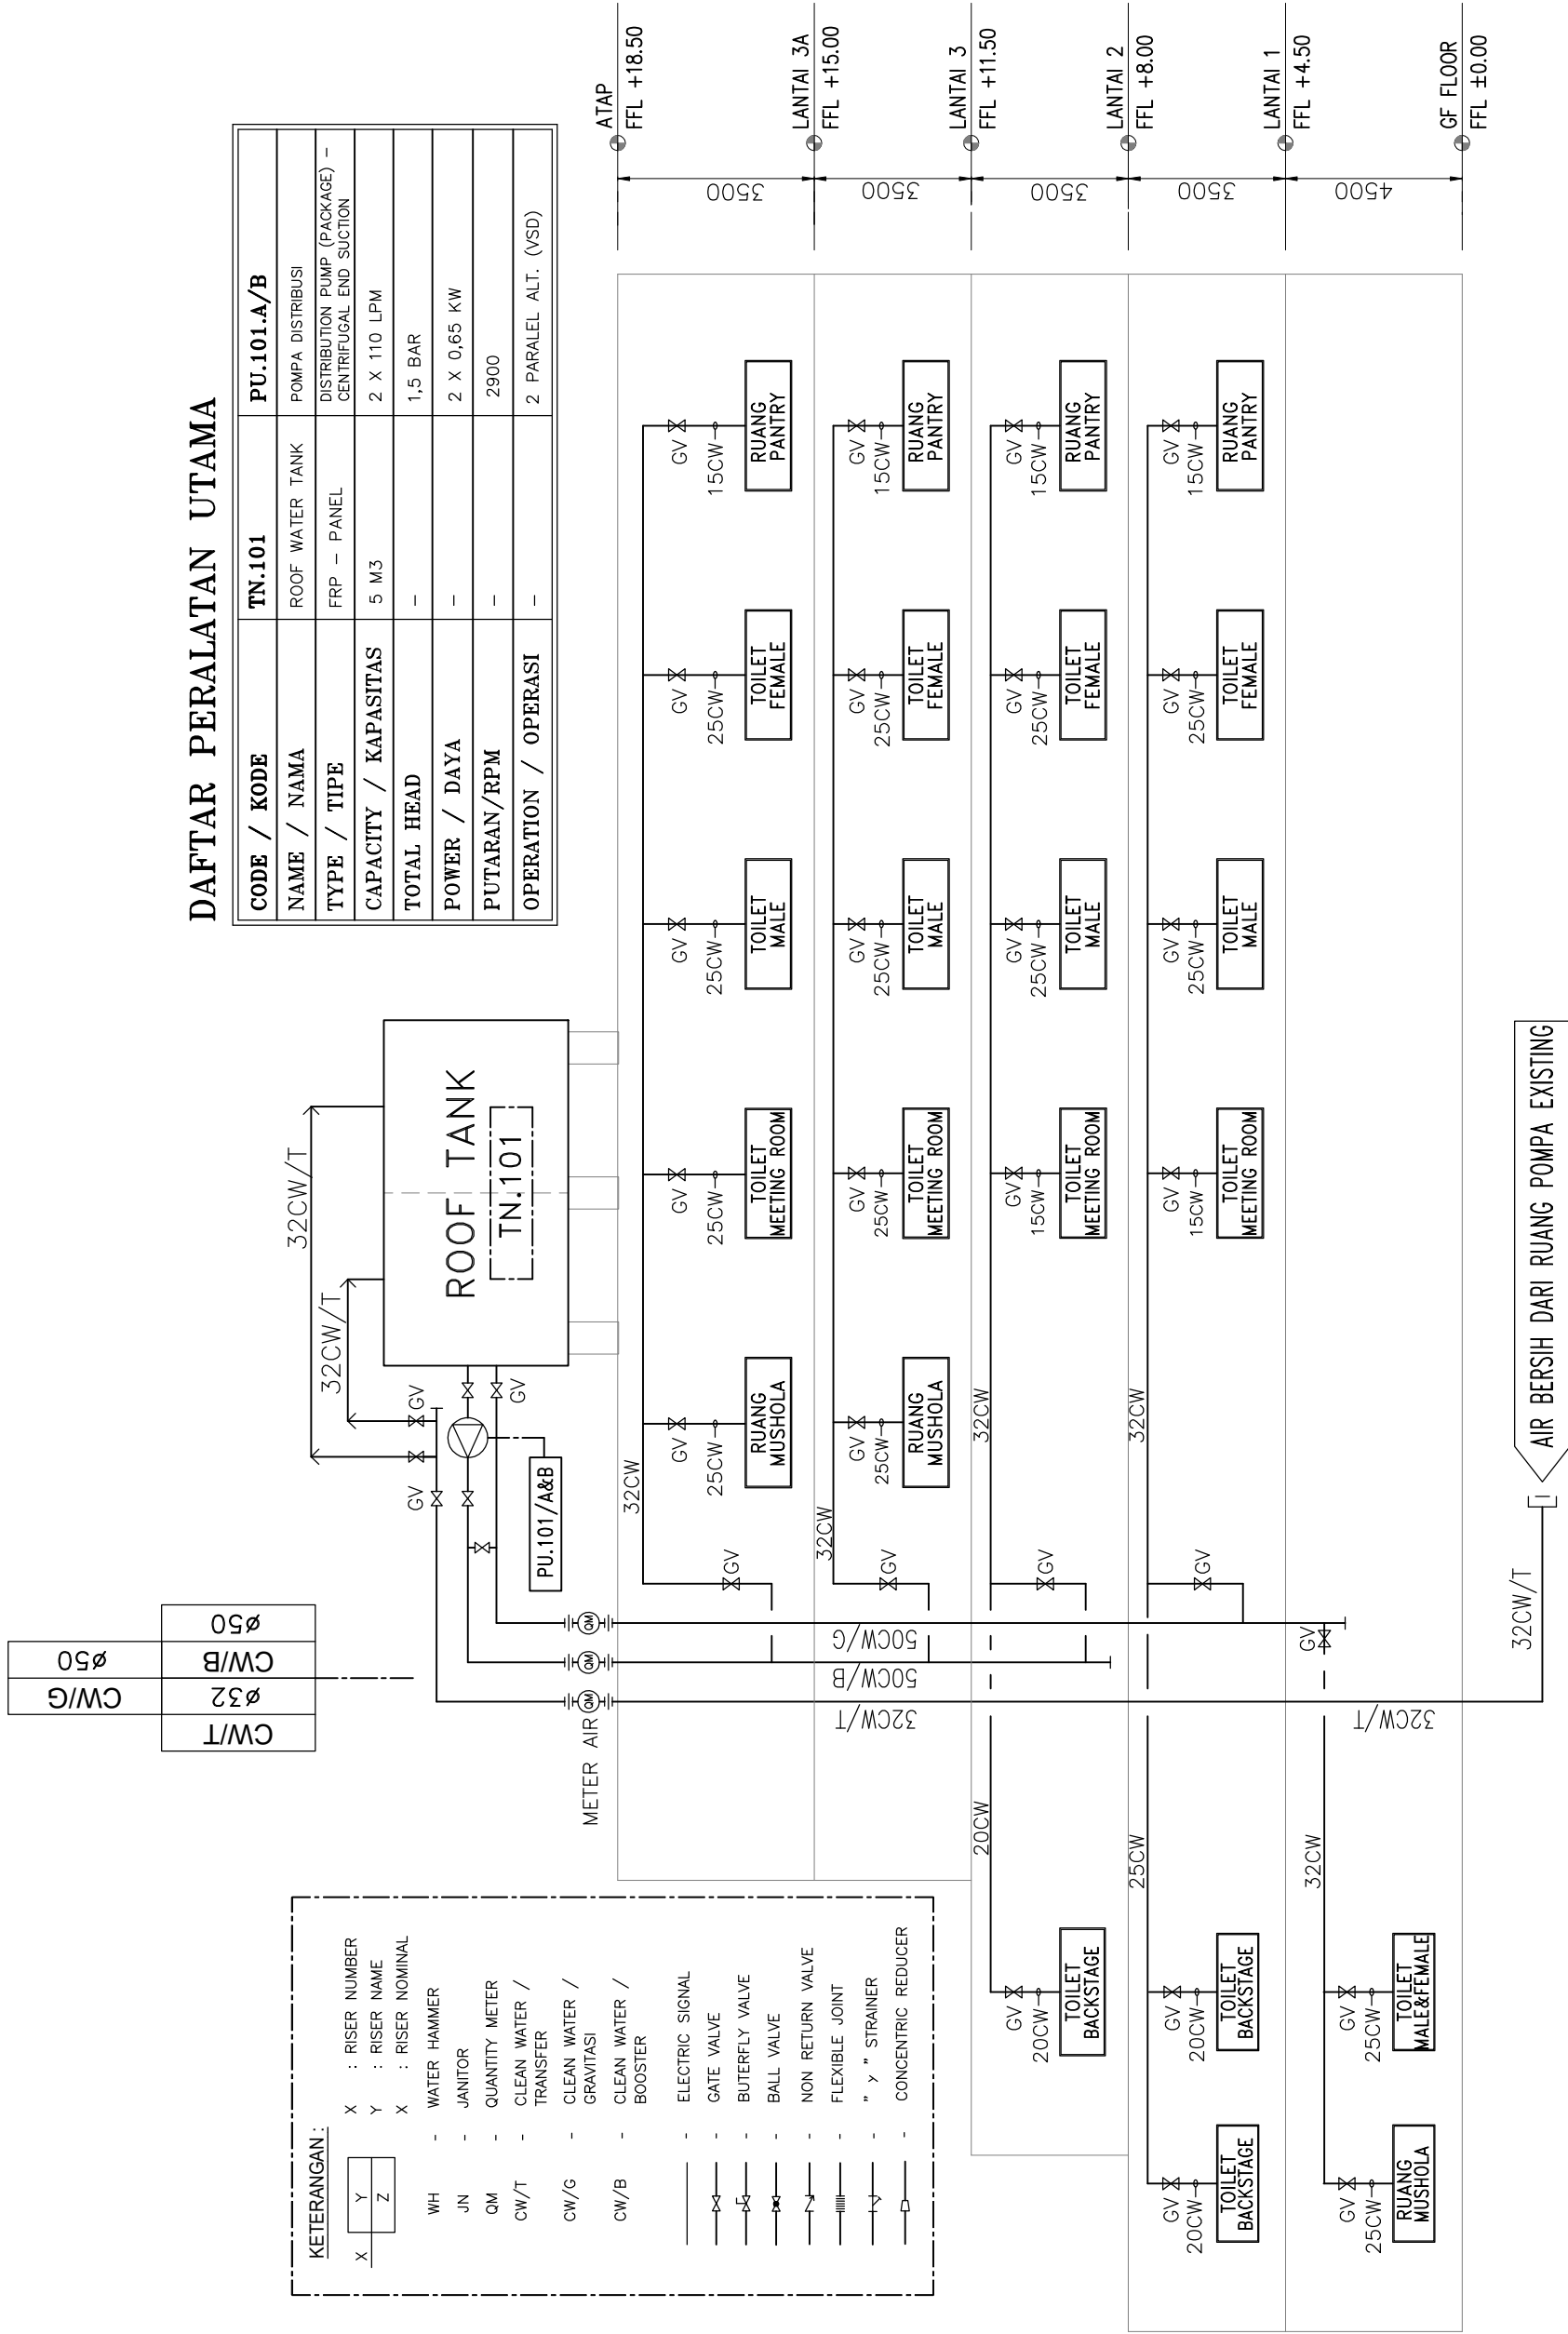

OWNER/CLIENT	<div><div><div></div><div></div><div></div><div></div></div><div>sawit</div></div> <div>APPROVED : .../.../...</div>	PROJECT BPDP KELAPA SAWIT Jl.Medan Merdeka Tim. RT.7/RW.1, Gambir, Kec. Gambir, Kota Jakarta Pusat, Daerah Khusus Ibukota Jakarta 10110	INTERIOR DESIGN CONSULTANT PT.M AGKASAMA Jl. Hari Sudi No. 4 Gd. Sekura Lt. 2 Room 201 Kel. Kampung Bali, Kec. Tanah Abang, Jakarta Pusat Telp. 021 - 2303483 Fax. 021 - 2303483 APPROVED : //	<div><div><div></div><div></div><div></div></div><div>PT DUTA PRATAMA ENGINEERING</div><div>MECHANICAL & ELECTRICAL ENGINEERING</div><div>Ruang Teman Menara Blok A No. 271, J. Bering Muka No. 1 Perumahan Bumi Pajajaran, Sektor 10, LRTD Mampang Ulu, Kecamatan Sukasari, Subkecamatan Tegalaya Kota Depok, Jawa Barat 16155 Email : dpepteam@gmail.com, pteam@ptepgk.com, 021-36874631</div></div>	DRAWING TITLE	DIAGRAM SISTEM AIR BERSIH	SCALE : NTS	ALL MEASUREMENT MUST BE CHECKED AT BY SITE BY THE CONTRACTORS AND ANY DIFFERENCES REPORTED/INITIALED TO THE DESIGNER FOR CONFIRMATION BEFORE PROCEEDING.	REVISION : R-1	DATE	DRAWING FOR	DRAWING NUMBER PL-101		
					DRAWN	Mamon	DATE : 15/05/24	CHECKED					Sopyan	DATE : 15/05/24
					.../.../...	.../.../...	.../.../...	.../.../...					.../.../...	.../.../...
					.../.../...	.../.../...	.../.../...	.../.../...					.../.../...	.../.../...
					.../.../...	.../.../...	.../.../...	.../.../...					.../.../...	.../.../...
					.../.../...	.../.../...	.../.../...	.../.../...					.../.../...	.../.../...
(signed)	(name) (position) (Dep./Div.)													